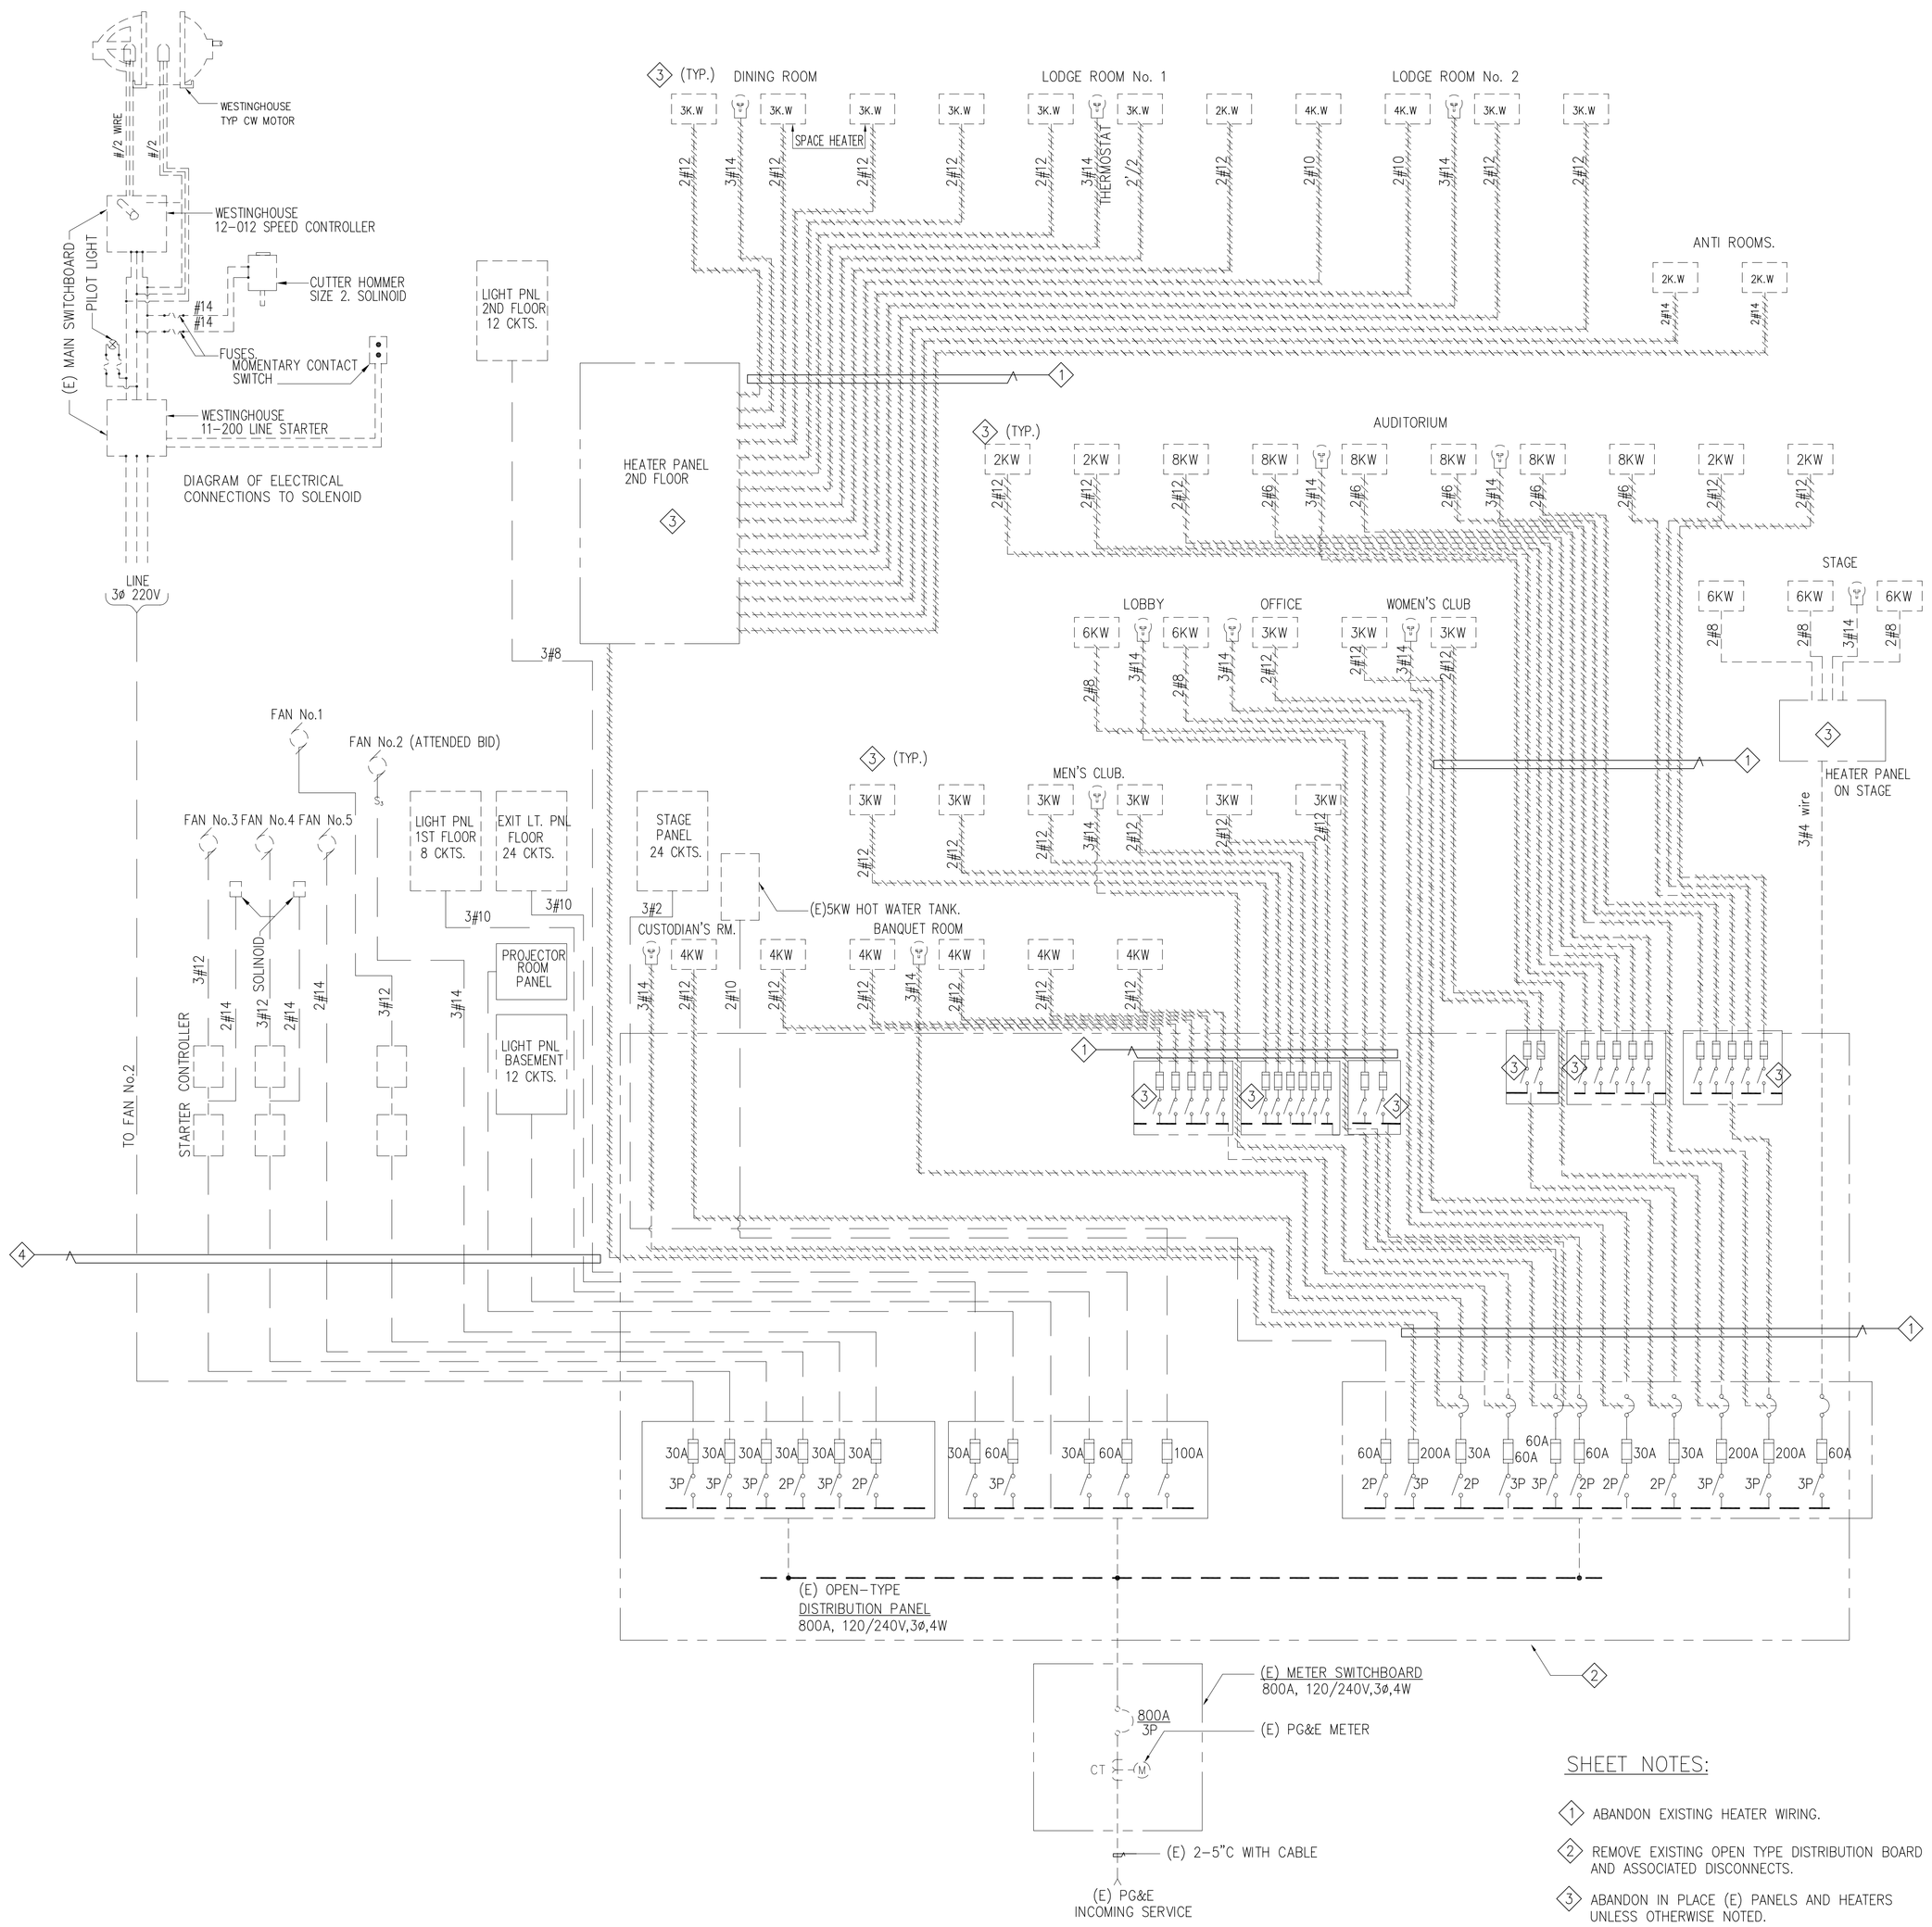

SHEET NOTES:

1. ABANDON EXISTING HEATER WIRING.
2. REMOVE EXISTING OPEN TYPE DISTRIBUTION BOARD AND ASSOCIATED DISCONNECTS.
3. ABANDON IN PLACE (E) PANELS AND HEATERS UNLESS OTHERWISE NOTED.
4. FULL (N) FEEDERS IN (E) CONDUITS. FOR (N) CABLE TERMINATION REFER TO NEW SLD DRAWING E0.4

DEMOLITION SINGLE LINE DIAGRAM

SCALE: NOT TO SCALE

1
E0.3

PLOT DATE:

ED2 international
Architects • Planners
945 Bryant Street, Suite 300
San Francisco, CA 94103
415.474.1400 tel
415.474.9110 fax

LICENSED ARCHITECT PETER W.T. WONG No. C-10636 9-30-13 RENEWAL DATE STATE OF CALIFORNIA

Architect Reg. No.

CITY OF Alameda

VETERAN MEMORIAL BUILDING

Electrical Systems Upgrade & Historical Renovations

2203 CENTRAL AVE.
ALAMEDA, CA 94501

Consultant

ACG engineers, inc.
CONSULTING ELECTRICAL ENGINEERS
7347 MISSION ST.,
DALY CITY, CA 94014

REGISTERED PROFESSIONAL ENGINEER ANTONIO C. JAKOBALEM No E15401 EXP. 06-30-13 ELECTRICAL STATE OF CALIFORNIA

Issuances and Revisions

No.	Date	Description
1	04-04-13	REVISION 1
2	07-03-13	PHASE 1 & 2

Date

Sheet Title

DEMOLITION SINGLE LINE DIAGRAM

Scale: NTS

Project No. 1301.00

E0.3

Sheet No. Revision